

INSTALLATION DATA SHEET

NMFH SERIES



WARNING!

1. TO PREVENT RISK OF ELECTRICAL SHOCK DEACTIVATE/DISCONNECT POWER SUPPLY BEFORE INSTALLING, MAINTAINING OR RELAMPING FIXTURE.
2. THIS FIXTURE SHOULD BE INSTALLED BY QUALIFIED TECHNICIANS IN STRICT ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ANY LOCAL REQUIREMENTS.

INSTALLATION

1. Before installing check the carton label and fixture to insure that you have correct fixture and voltage.
2. BEFORE INSTALLING, MAKE CERTAIN THAT THE CIRCUIT IS DEACTIVATED.
3. Fixture can be suspended from ceiling or surface mounted, see typical installations. This fixture is intended to be installed facing down only.
4. For supply connection use wire suitable for at least 90° C.
5. Remove lens, lamps and reflector.
6. Connect internal wires per wiring diagram on ballast, according to NEC requirements.
7. Install reflector, lamps and lens.

MAINTENANCE DATA

CAUTION: DISCONNECT THE SUPPLY CIRCUIT BEFORE OPENING THE FIXTURE.

To relamp, open lens, replace lamps, then replace lens.



AZZ/RAL
8500 Hansen Rd
Houston, TX 77075

Tel: (713) 943-0340
Fax: (713) 943-8354
Email: info@rigalite.com


Visit us at:
<http://www.rigalite.com>

TYPICAL INSTALLATIONS

NMFH SERIES




Fixed Mount Bracket Kit
Catalog Number: 53115

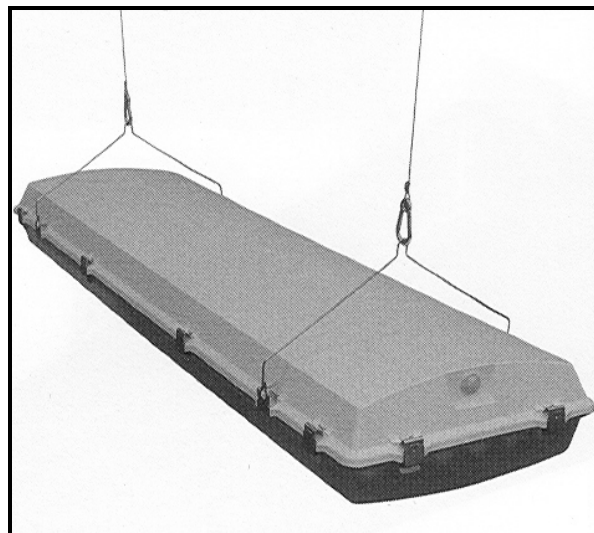

Stainless Steel V-Hooks
Catalog Number: 86228
2 required per fixture
Cable and snap hooks supplied by others



Fixed Mount Bracket using removable hooks.
Catalog number: 86230
2 required per fixture

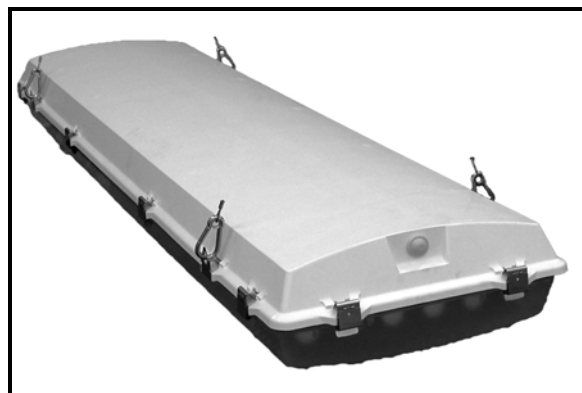

Chain Mounted Fixture
Chain and snap hooks supplied by others



AZZ/RAL
8500 Hansen Rd
Houston, TX 77075

Tel: (713) 943-0340
Fax: (713) 943-8354
Email: info@rigalite.com

Visit us at:
<http://www.rigalite.com>